


Typical Installation

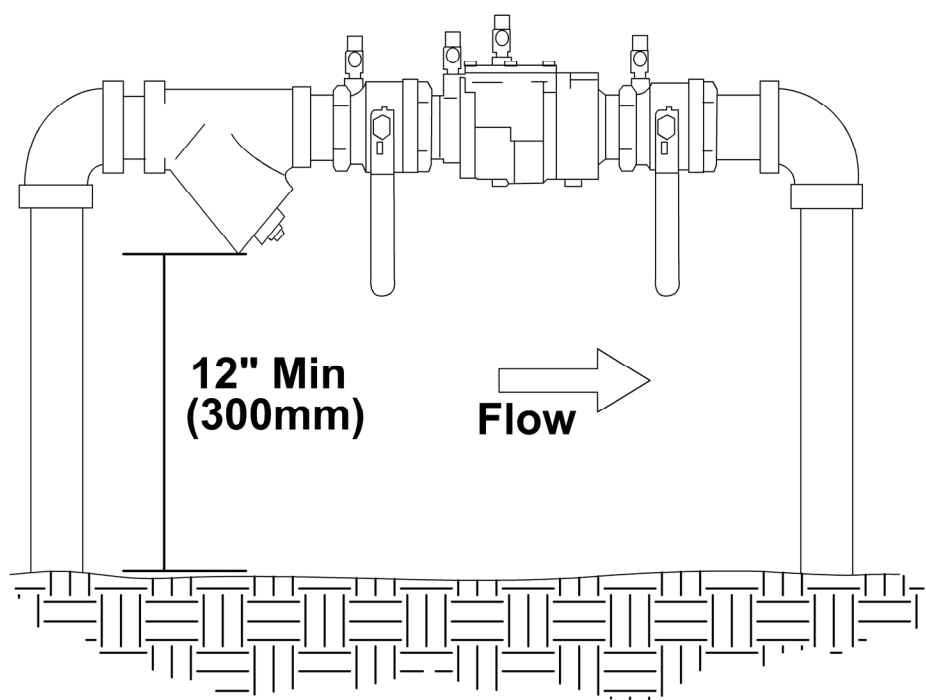

FEBCO (MODEL 850) DOUBLE CHECK VALVE ASSEMBLY

Notes:

1. Assembly must be installed with a minimum of 12 inches between the lowest portion of the assembly and grade, floor or platform.
2. Pipe unions required on both ends of double check valve.

NOT TO SCALE

STANDARD
DETAIL

CITY OF BRISBANE
DEPARTMENT OF PUBLIC WORKS

DATE: 10/15/19

RESIDENTIAL
DOUBLE CHECK VALVE ASSEMBLY

W-8C